


Insert site map highlighting areas with odour issues; see example of Wanlip STW

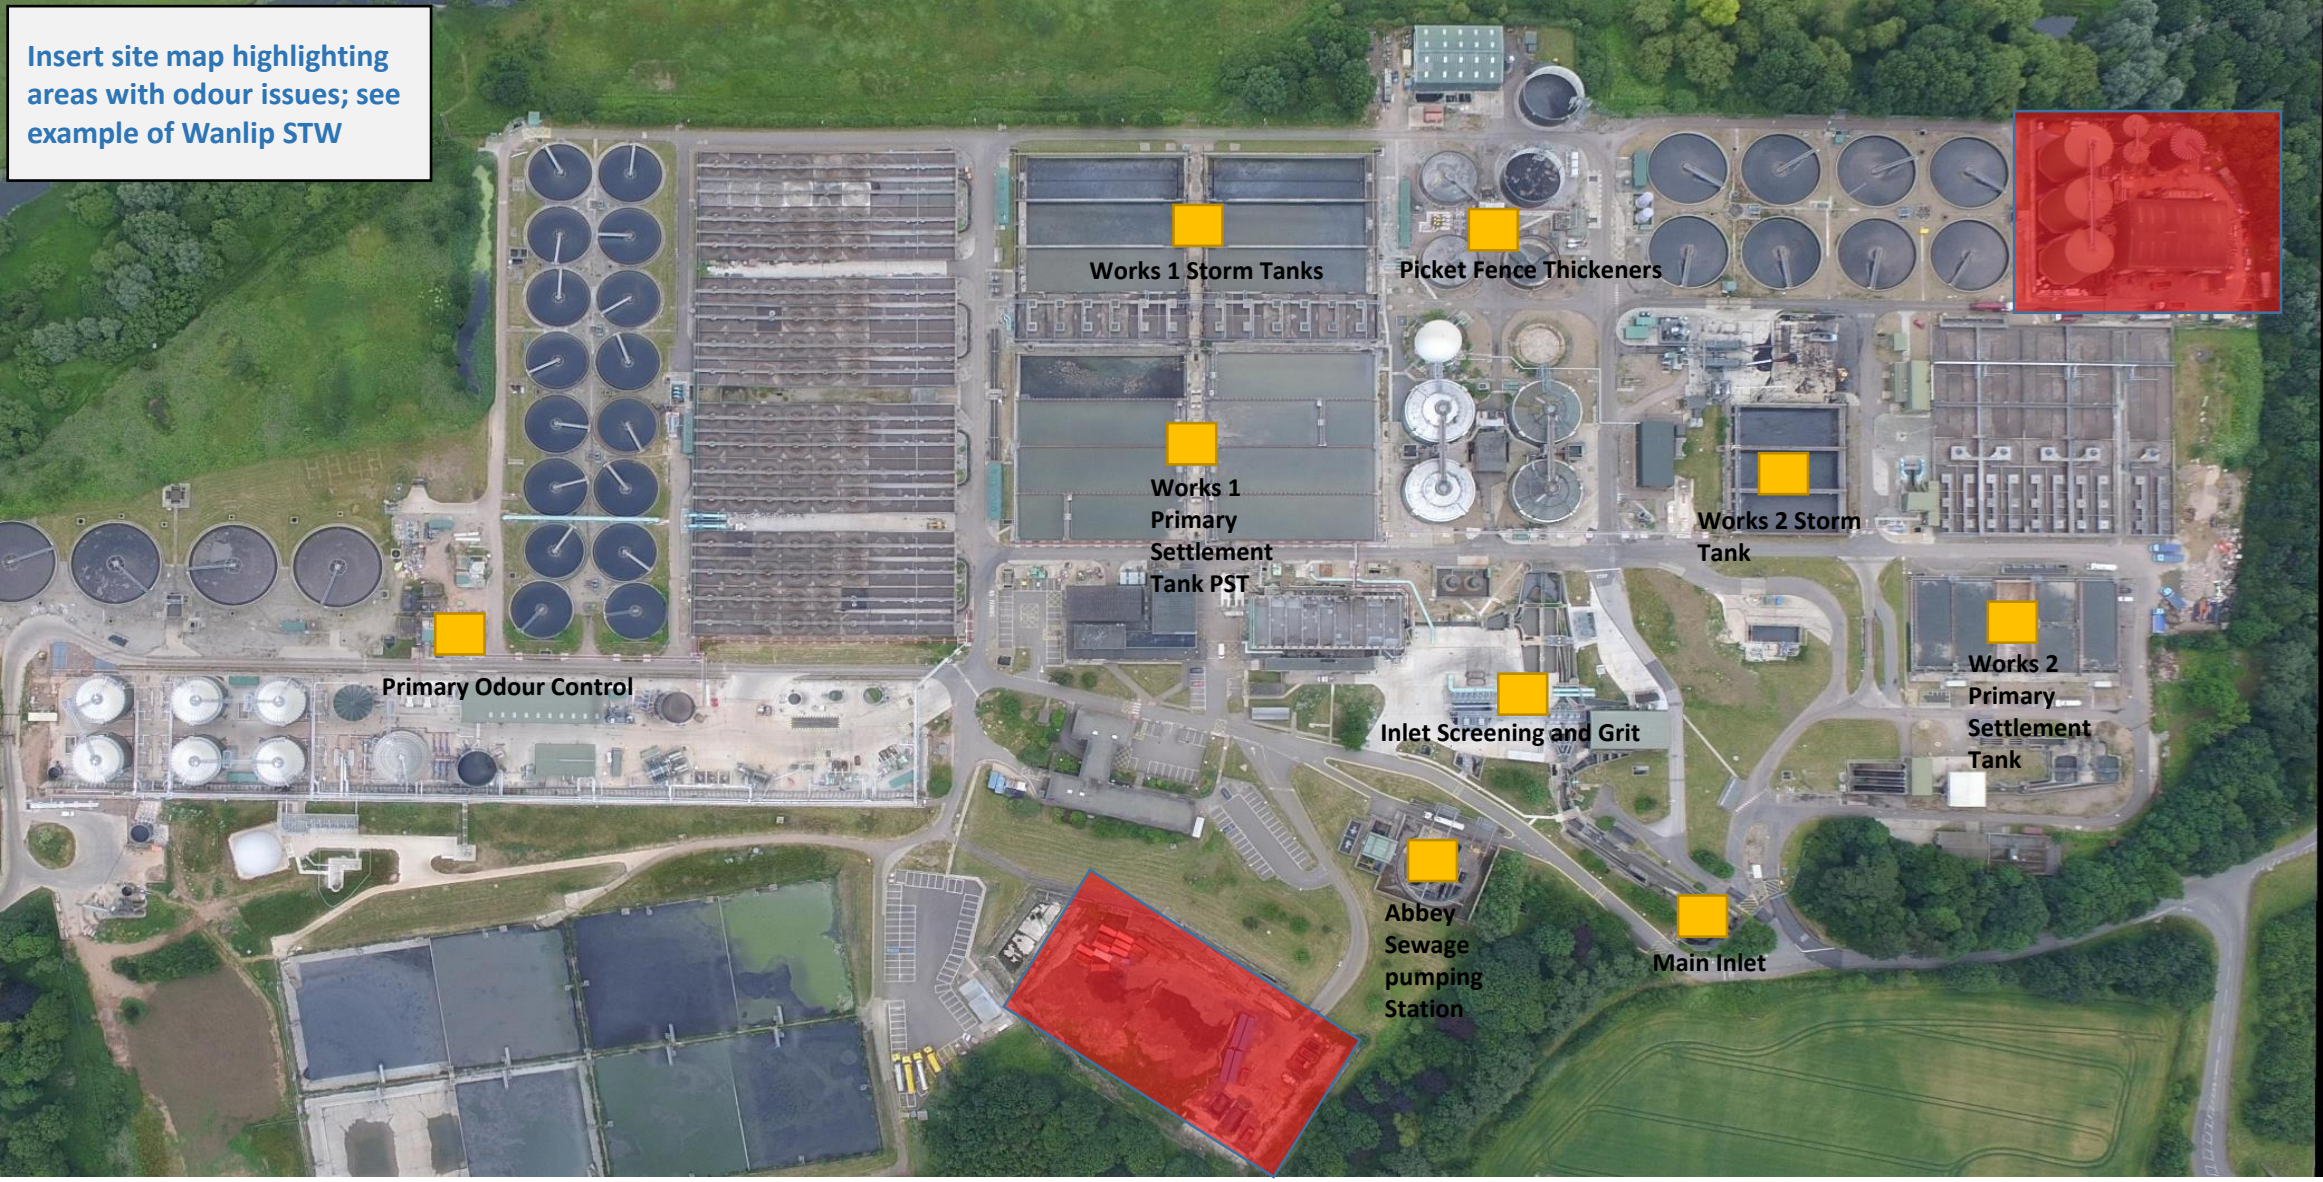

 Odour site visit checks

 Biffa

**Site Odour Check List**

Site name: Wanlip

Time and Date: 10:00 04/04/24

Print Initials: ES

Circle: Reactive or **Proactive** (Record customer details in actions/next steps for Reactive complaints)

**1. Wind direction**

Specify..... 9 mph North East

**2. Flows into works/ FFT 3600 L/S**

High (3000-3600 L/s) Medium (1500-3000 l/s) Low (0-1500 l/s)

**Actual flow -** 3558 L/S

**8. Weather conditions:**

Specify – light drizzle

**9. Odour present at inlet channel?**

High Medium **Low**

**3. Odour present on site SPS?**

Yes **No**

**4. Screenings and grit removed from site as per contact agreement (Inlet, PFT and CDE)?**

**Yes** No

**5. Out of service PST's drained and cleaned?**

**Yes** No

**6. Out of service PFT's drained and cleaned?**

**Yes** No

**7. PFT and PST Red Golden Measure ALB's?**

**Yes** No

**Actions/Next Steps/ OOS Assets/ Any additional information regarding site issues etc.**

- Site is healthy
- Biffa have 3 shutter doors open
- N/W PST 4 O.O.S
- O/W FST 5 (valve dropped,summer job)

**Key:**

- CDE screens = imported sludge screens
- PST = primary settlement tanks
- PFT = Picket Fence Thickener
- SPS = sewage pumping station
- ALB = action limit breach
- L/S = Litres per second
- FFT = Full flow treatment before we divert to storm tanks

**10. Any odour present at plants operated by other businesses (e.g. Biffa)?**

High **Medium** Low

**11. Is on site odour control working?**

**YES** NO

**12. Any other operational issue potentially effecting odour?**

YES **NO**

**13. Any other known area odours?**

YES **NO**

**14. Storm tanks O/W, N/W**

FULL EMPTY RETURNING **FILLING**

**15. Storm tanks drained and cleaned (if possible)**

YES **NO**