


Insert site map highlighting areas with odour issues; see example of Wanlip STW

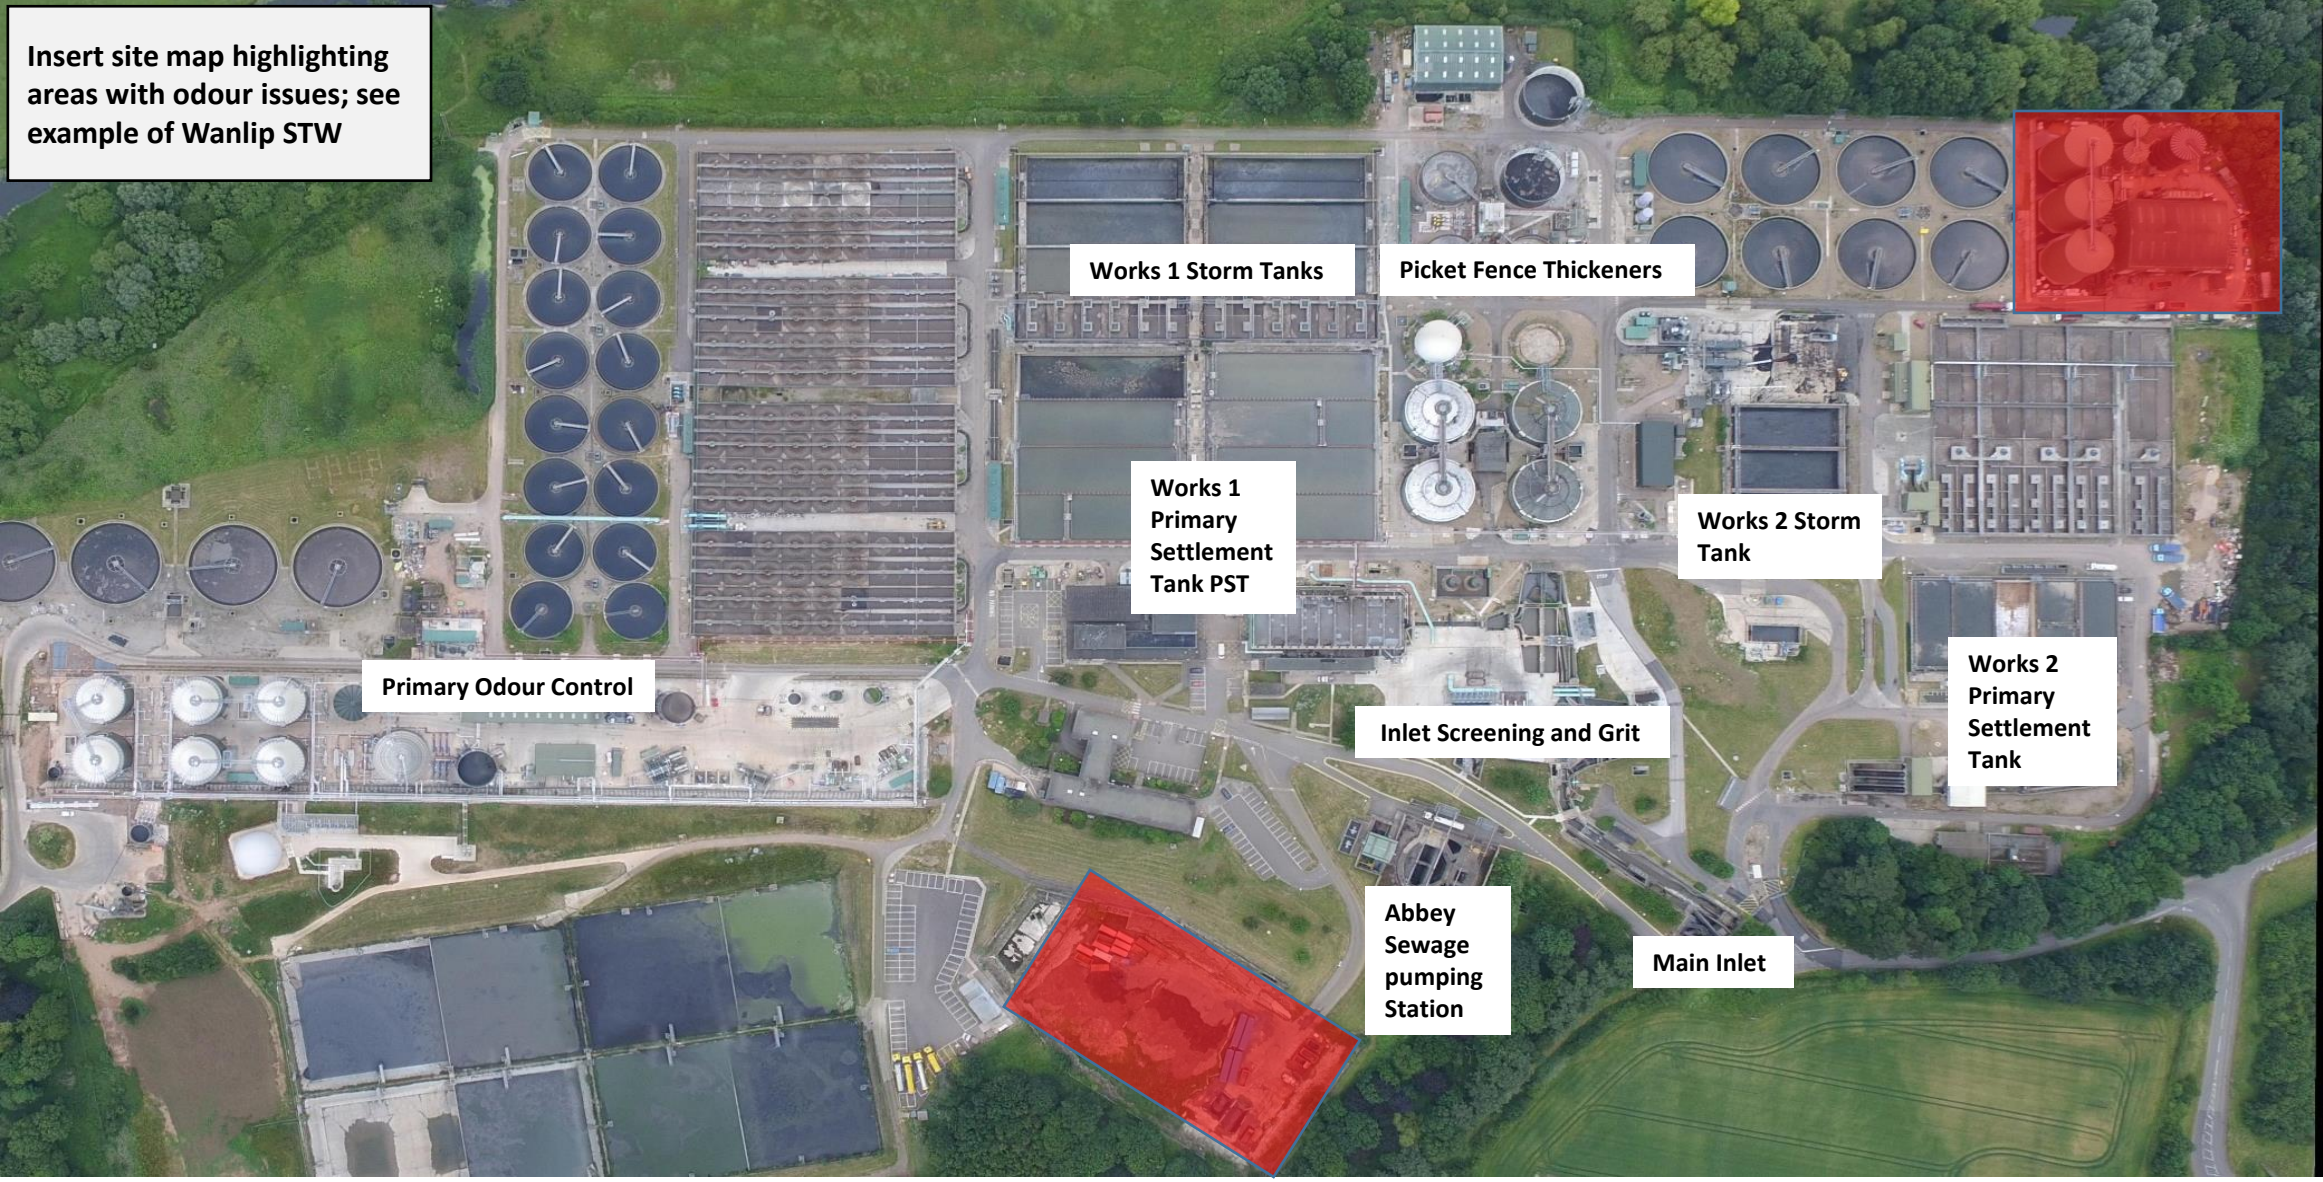

Odour site visit checks

Biffa

Site Odour Check List

Site name: Wanlip

Time and Date: 018/11/2024

Print Initials: DW

Circle: Reactive or **Proactive** (Record customer details in actions/next steps for Reactive complaints)

1. Wind direction

Specify..... 2degrees NNW

8. Weather conditions

Specify - Overcast - Dry

2. Flows into works/ FFT 3600 L/S

High (2800-3600 L/s) **Medium** (1300-2800 l/s) Low (0-1300 l/s)

9. Odour present at inlet channel?

High **Medium** Low

Actual flow -

2284 L/S

3. Odour present at on site SPS?

Yes **No**

4. Screenings and grit removed from site as per contact agreement (Inlet, PFT and CDE)?

Yes No

5. Out of service PST's drained and cleaned?

Yes **No**

6. Out of service PFT's drained and cleaned?

Yes No

7. PFT and PST Red Golden Measure ALB's?

Yes **No**

Actions/Next Steps/ OOS Assets/ Any additional information regarding site issues etc.

Biffa: Garage doors open 2

10. Any odour present at plants operated by other businesses (e.g. Biffa)?

Medium Low

11. Is on site odour control working?

YES NO

13. Any other operational issue potentially effecting odour?

YES **NO**

13. Any other known area odours?

YES **NO**

Key:

- CDE screens = imported sludge screens
- PST = primary settlement tanks
- PFT = Picket Fence Thickener
- SPS = sewage pumping station
- ALB = action limit breach
- L/S = Litres per second
- FFT = Full flow treatment before we divert to storm tanks